INSTALLATION GUIDE
FTC – Field Termination Connector

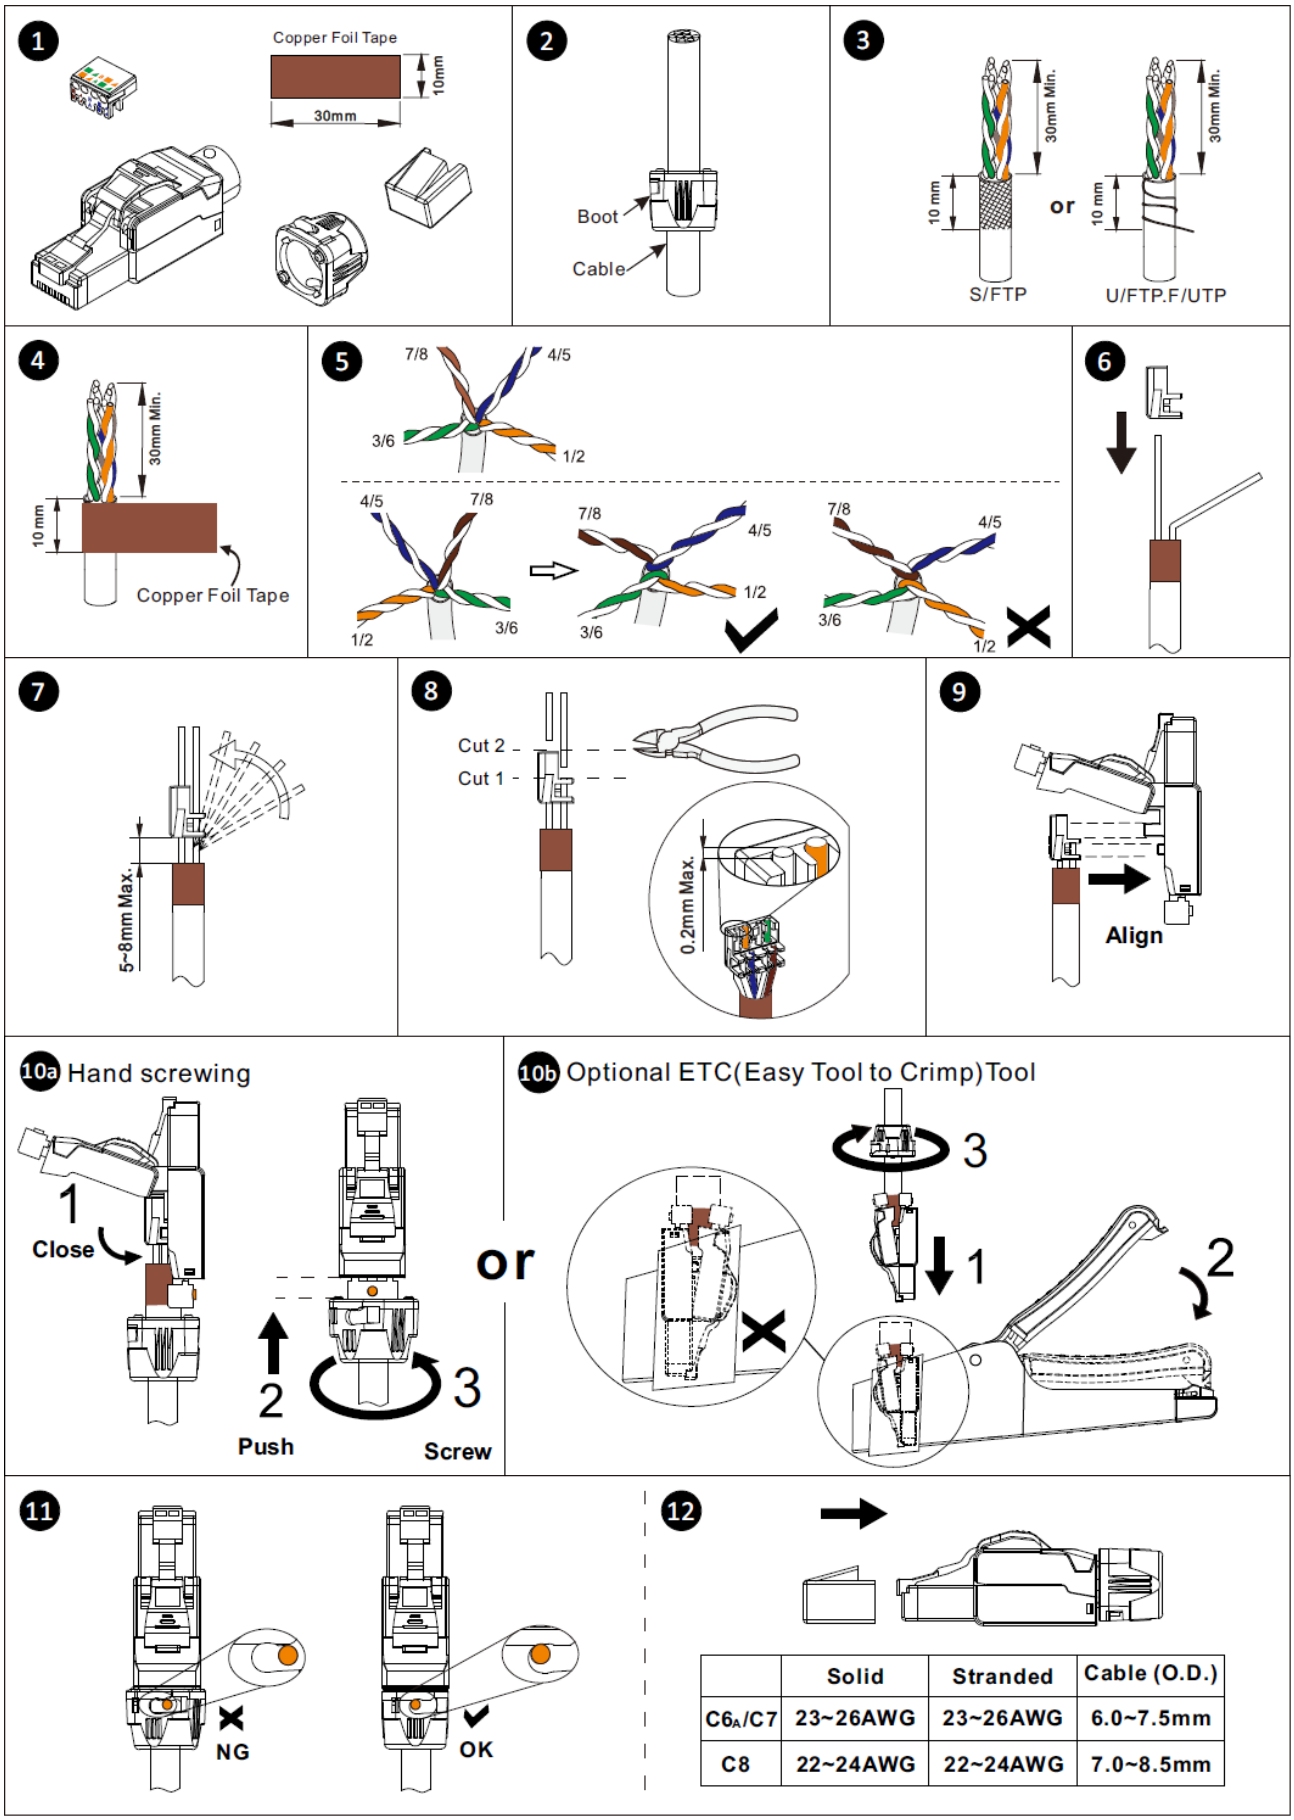

	Solid	Stranded	Cable (O.D.)
C6A/C7	23~26AWG	23~26AWG	6.0~7.5mm
C8	22~24AWG	22~24AWG	7.0~8.5mm